




# MONITORED Rack PDU Specification

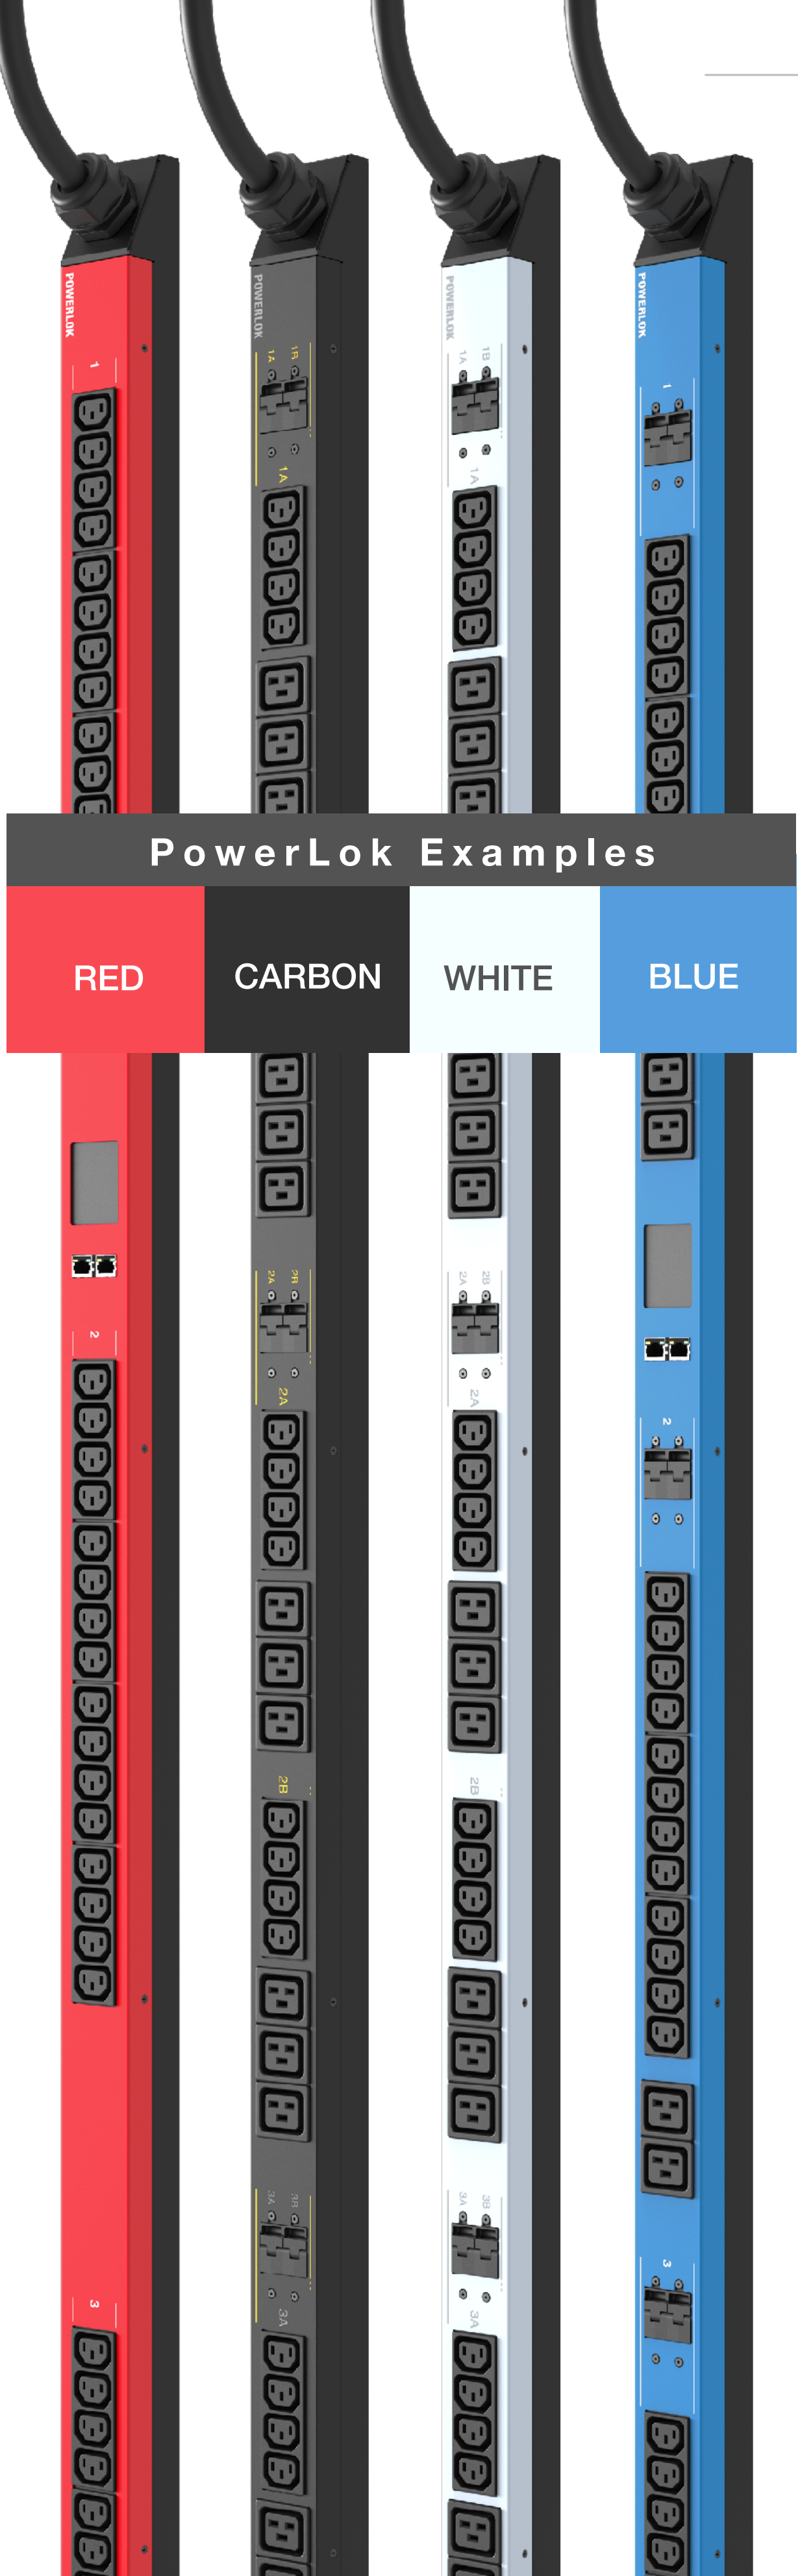


CUSTOMER SIGNATUREDATE APPROVED

Customer agrees to this specific PowerLok configuration


|                                                                                                                                                                                                     |                            |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------|
| <b>PowerLok Configuration</b><br>Model: <b>PL7103</b><br><br><b>RACK PDU, BASIC, 72", 20A</b><br><b>120/208V 3PH (5.7 kW), 48-C13</b><br><b>(2)5-15R, 10FT WHIP, NEMA L21-20P,</b><br><b>CARBON</b> |                            |
| POWER                                                                                                                                                                                               | 20A 120/208V 3PH<br>5.7 kW |
| UNIT LENGTH                                                                                                                                                                                         | 72 IN                      |
| PLUG TYPE                                                                                                                                                                                           | NEMA L21-20P               |
| WHIP LENGTH                                                                                                                                                                                         | 10 FT                      |
| RECEPTACLES                                                                                                                                                                                         | 48-C13                     |
| CORDLOK                                                                                                                                                                                             | NONE                       |
| MONITORING                                                                                                                                                                                          | NONE                       |
| 120V<br>TECH POWER                                                                                                                                                                                  | (2)5-15R                   |
| COLOR                                                                                                                                                                                               | CARBON                     |

|                                                                                    |                                                                                                               |
|------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------|
| <b>PowerLok Universal Specification</b><br>Quote:Customer:<br>Order No.:Order Qty: |                                                                                                               |
| Over Current Protection                                                            | 20A magnetic breakers on 30A models.                                                                          |
| Power Whip                                                                         | 20A: 12AWG 3 or 5 wire & 30A: 10AWG 3 or 5 wire.                                                              |
| Operating Temperature                                                              | Full nameplate continuous operation: 0-50C (32-122F)                                                          |
| Heavy Steel - Powder Coat Color                                                    | See PowerLok Configuration Table for Color                                                                    |
| Rack PDU Type                                                                      | Vertical Rack-mount                                                                                           |
| Toolless Mounting: Center Spacing                                                  | 61.25in (12.25 spacing standard). 59.05 mounting option available on Rack PDU.                                |
| Assembled in the USA                                                               | Yes - with local and off-shore sourced components                                                             |
| Product Warranty                                                                   | 3-year from date of shipment, repair or replace.                                                              |
| Certification/Agency Approvals                                                     | TUV Certified to UL/CSA 60950-1 with NOM Addendum for Mexico, FCC Part 15 Class A Conformance, RoHS Compliant |
| Operating Environment                                                              | 0-50C (32-122F), 5-95% Relative Humidity, 0-10,000ft (0-3000 meters) Elevation.                               |
| Storage Environment                                                                | -25-65C (32-122F), 5-95% Relative Humidity, 0-10,000ft (0-3000 meters) Elevation.                             |
| Chassis Dimensions (LxWxD)                                                         | 72"L x 2.18"W x 2.0"D                                                                                         |
| Package Dimensions (LxWxD)                                                         | 84.0"L x 22.0"W x 5.0"D (4-Pack)<br>84.0"L x 11.0"W x 5.0"D (2-Pack)<br>84.0"L x 7.0"W x 5.0"D (1-Pack)       |
| Rack PDU Weight                                                                    | 15.0 lbs. (Actual weight varies slightly based on configuration)                                              |
| Packaged Weight                                                                    | 17.0 lbs (1 unit - actual weight varies slightly based on configuration)                                      |

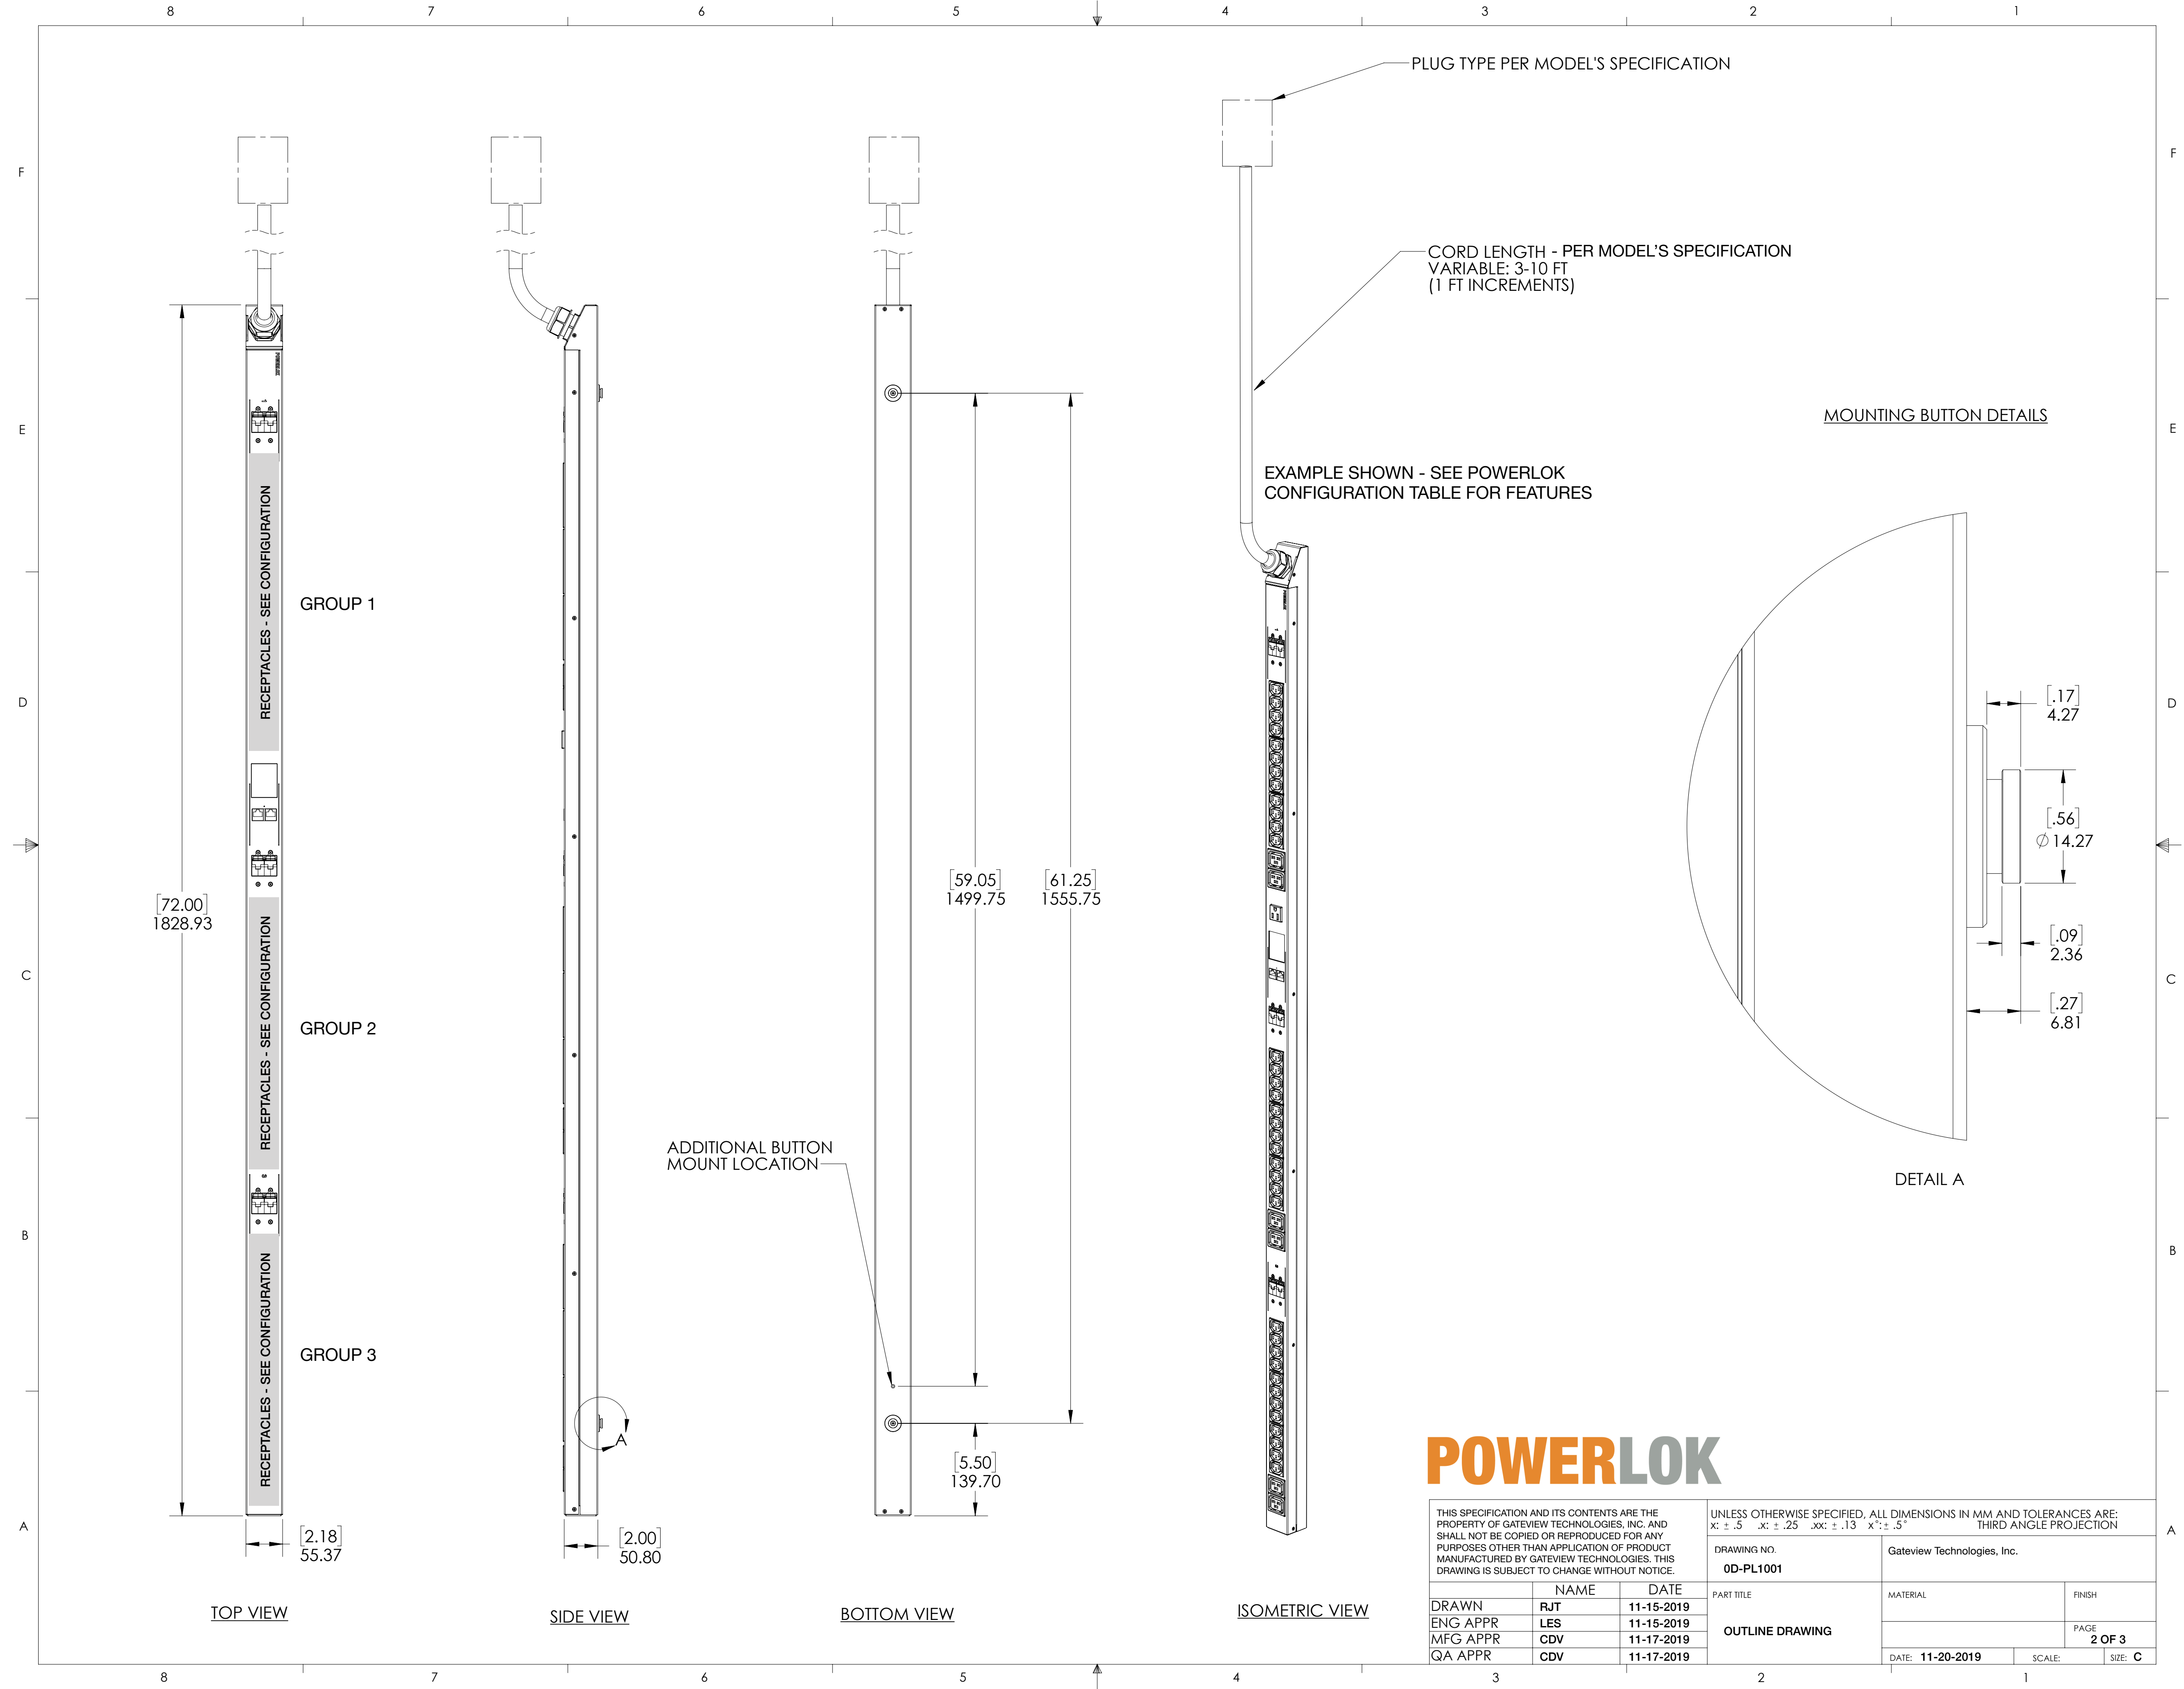

POWERLOK

|                                                                                                                                                                                                                                                                       |  |                             |                                                                                                                                                   |            |  |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|-----------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------|------------|--|
| THIS SPECIFICATION AND ITS CONTENTS ARE THE PROPERTY OF GATEVIEW TECHNOLOGIES, INC. AND SHALL NOT BE COPIED OR REPRODUCED FOR ANY PURPOSES OTHER THAN APPLICATION OF PRODUCT MANUFACTURED BY GATEVIEW TECHNOLOGIES. THIS DRAWING IS SUBJECT TO CHANGE WITHOUT NOTICE. |  |                             | UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS IN MM AND TOLERANCES ARE:<br>X: ± .5    .X: ± .25    .XX: ± .13    X": ± .5"    THIRD ANGLE PROJECTION |            |  |
| DRAWING NO.                                                                                                                                                                                                                                                           |  | Gateview Technologies, Inc. |                                                                                                                                                   |            |  |
| 0D-PL1001                                                                                                                                                                                                                                                             |  |                             |                                                                                                                                                   |            |  |
| PART TITLE                                                                                                                                                                                                                                                            |  | MATERIAL                    |                                                                                                                                                   | FINISH     |  |
| OUTLINE DRAWING                                                                                                                                                                                                                                                       |  |                             |                                                                                                                                                   | PAGE       |  |
|                                                                                                                                                                                                                                                                       |  |                             |                                                                                                                                                   | 2 OF 3     |  |
| DATE: 11-20-2019                                                                                                                                                                                                                                                      |  | SCALE:                      |                                                                                                                                                   | SIZE: C    |  |
| DRAWN                                                                                                                                                                                                                                                                 |  | NAME                        |                                                                                                                                                   | DATE       |  |
| ENG APPR                                                                                                                                                                                                                                                              |  | RJT                         |                                                                                                                                                   | 11-15-2019 |  |
| MFG APPR                                                                                                                                                                                                                                                              |  | LES                         |                                                                                                                                                   | 11-15-2019 |  |
| QA APPR                                                                                                                                                                                                                                                               |  | CDV                         |                                                                                                                                                   | 11-17-2019 |  |

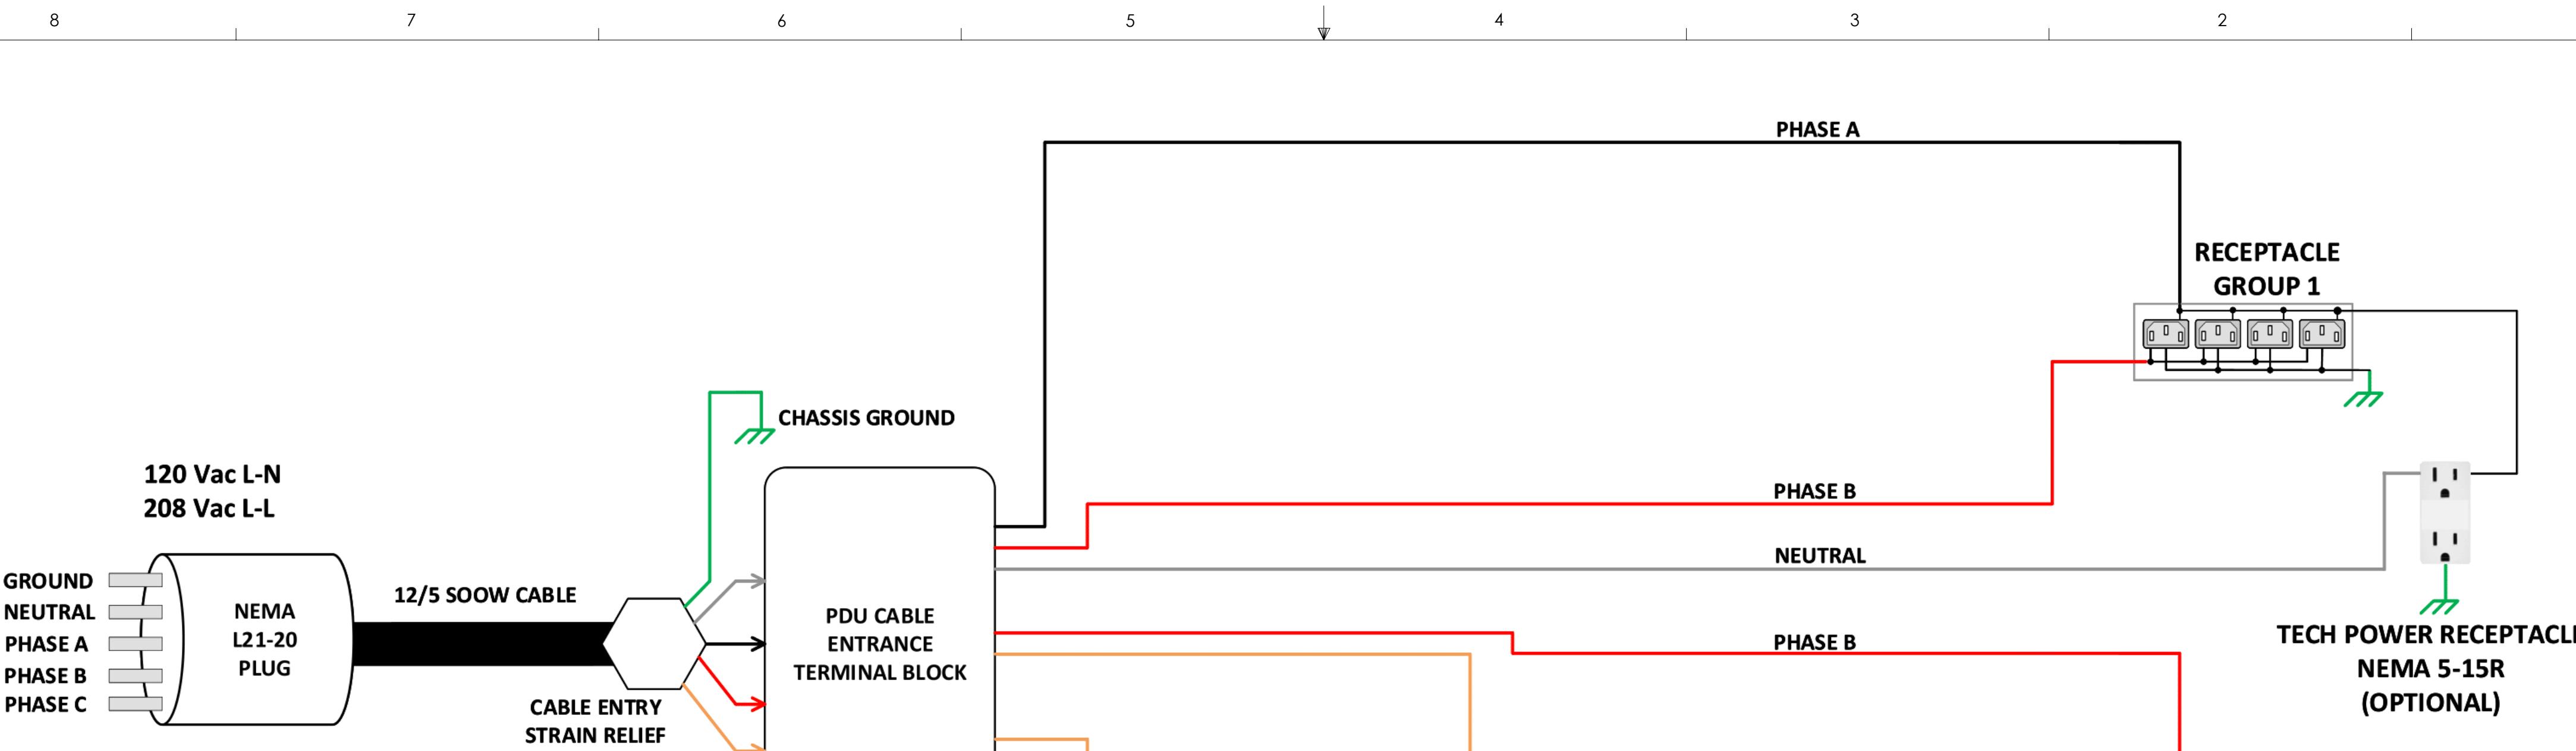

# 20A THREE PHASE 120/208 Vac PDU INTERNAL WIRING CONFIGURATION

- NOTES:**
- 1) Input cable: 5 wire, 12AWG, SOOW with L21-20 plug
  - 2) Internal wiring to group outlets is 12AWG

POWERLOK

|                                                                                                                                                                                                                                                                       |             |                   |                                                                                                                                                      |                                                              |                   |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------|-------------------|------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------|-------------------|
| THIS SPECIFICATION AND ITS CONTENTS ARE THE PROPERTY OF GATEVIEW TECHNOLOGIES, INC. AND SHALL NOT BE COPIED OR REPRODUCED FOR ANY PURPOSES OTHER THAN APPLICATION OF PRODUCT MANUFACTURED BY GATEVIEW TECHNOLOGIES. THIS DRAWING IS SUBJECT TO CHANGE WITHOUT NOTICE. |             |                   | UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS IN MM AND TOLERANCES ARE:<br>X": ± .5    .X": ± .25    .XX": ± .13    X'": ± .5<br>THIRD ANGLE PROJECTION |                                                              |                   |
|                                                                                                                                                                                                                                                                       |             |                   | DRAWING NO.<br>WC-PL1001                                                                                                                             | Gateview Technologies, Inc.<br>INTERNAL WIRING CONFIGURATION |                   |
| DRAWN                                                                                                                                                                                                                                                                 | NAME<br>LES | DATE<br>4-20-2019 | PART TITLE                                                                                                                                           | MATERIAL                                                     | FINISH            |
| ENG APPR                                                                                                                                                                                                                                                              | MHG         | 4-20-2019         | 20A THREE PHASE 120/208 Vac<br>PDU                                                                                                                   |                                                              | PAGE<br>3 OF 3    |
| MFG APPR                                                                                                                                                                                                                                                              | CDV         | 4-21-2019         |                                                                                                                                                      |                                                              |                   |
| QA APPR                                                                                                                                                                                                                                                               | CDV         | 4-21-2019         |                                                                                                                                                      | DATE: 4-20-2019                                              | SCALE:    SIZE: C |